

Ultrasound Operations Qualify

sams2, 121f05 at LAB1O1, ER2, Upper Z Panel:[185.17 38.55 149.93]


250.0 sa/sec (100.0 Hz)

$\Delta f = 0.122$ Hz, Nfft = 2048

Temp. Res. = 8.192 sec, No = 0

SAMS2, 121f05

Start GMT 25–September–2003, 268/08:00:00

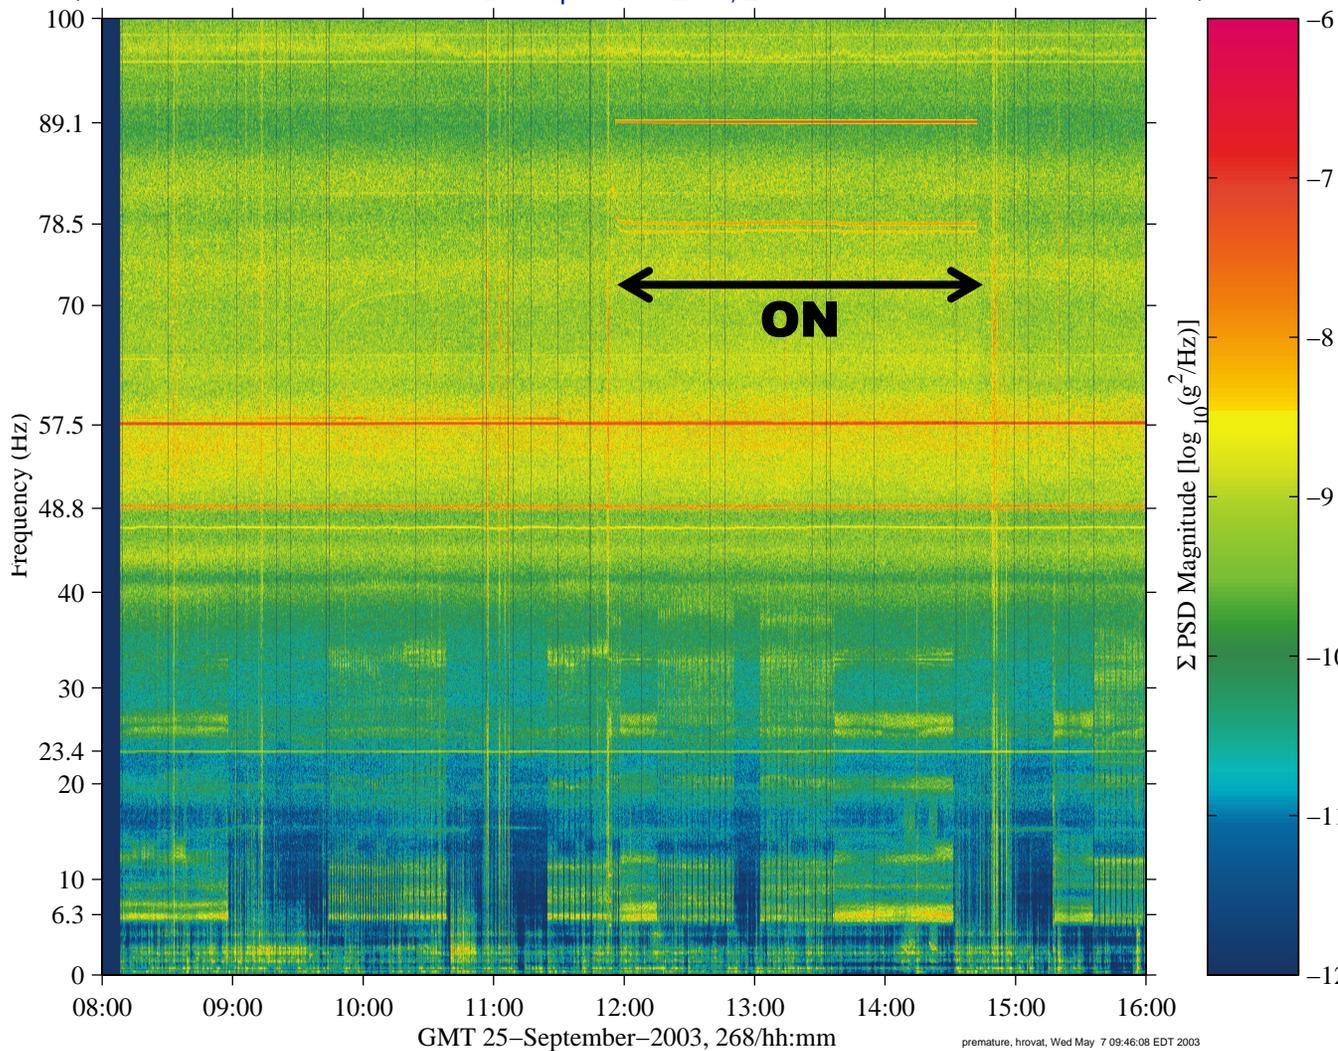

Data Description	
Sensor	121f05 250.0 sa/sec (100.0 Hz)
Location	LAB1O1, ER2, Upper Z Panel
Inc/Flight	Increment: 7, Flight: 6S
Plot Type	spectrogram

Notes:


This spectrogram shows three narrowband disturbances that appear related to ultrasound operations. The highest frequency component is centered at about 89.1 Hz (~5346 RPM), while there are twin lower frequency signals at about 77.7 and 78.6 Hz. All three signals turn on/off simultaneously, and analysis of the data set used to generate this figure indicates that the equipment was turned on at approximately GMT 11:55 and off at about GMT 14:42 for the duration of 2 hours and 47 minutes. Canvassing of the vibratory acceleration archive collected on the ISS shows the appearance of similar signatures for the following GMTs:

- 07-Feb-2002, 038/14:00-15:00
- 08-Feb-2002, 039/07:32-09:30
- 06-Mar-2003, 065/10:40-12:25
- 24-Jun-2003, 175/13:09-15:48
- 25-Sep-2003, 268/12:00-14:45

Regime:	Vibratory
Category:	Equipment
Source:	Ultrasound Operations



Microgravity Science Division




Glenn Research Center

Ultrasound Operations Quantify

sams2, 121f05 at LAB1O1, ER2, Upper Z Panel:[185.17 38.55 149.93]
 250.0 sa/sec (100.0 Hz)
 $\Delta f = 0.122$ Hz, Nfft = 2048
 Temp. Res. = 8.192 sec, No = 0
RED: $77.3 < f < 78.9$ Hz, BLUE: $88.9 < f < 89.5$ Hz
 Start GMT 25–September–2003, 268/08:00:00

sum
 Hanning, k = 3429
 Span = 8.00 hours

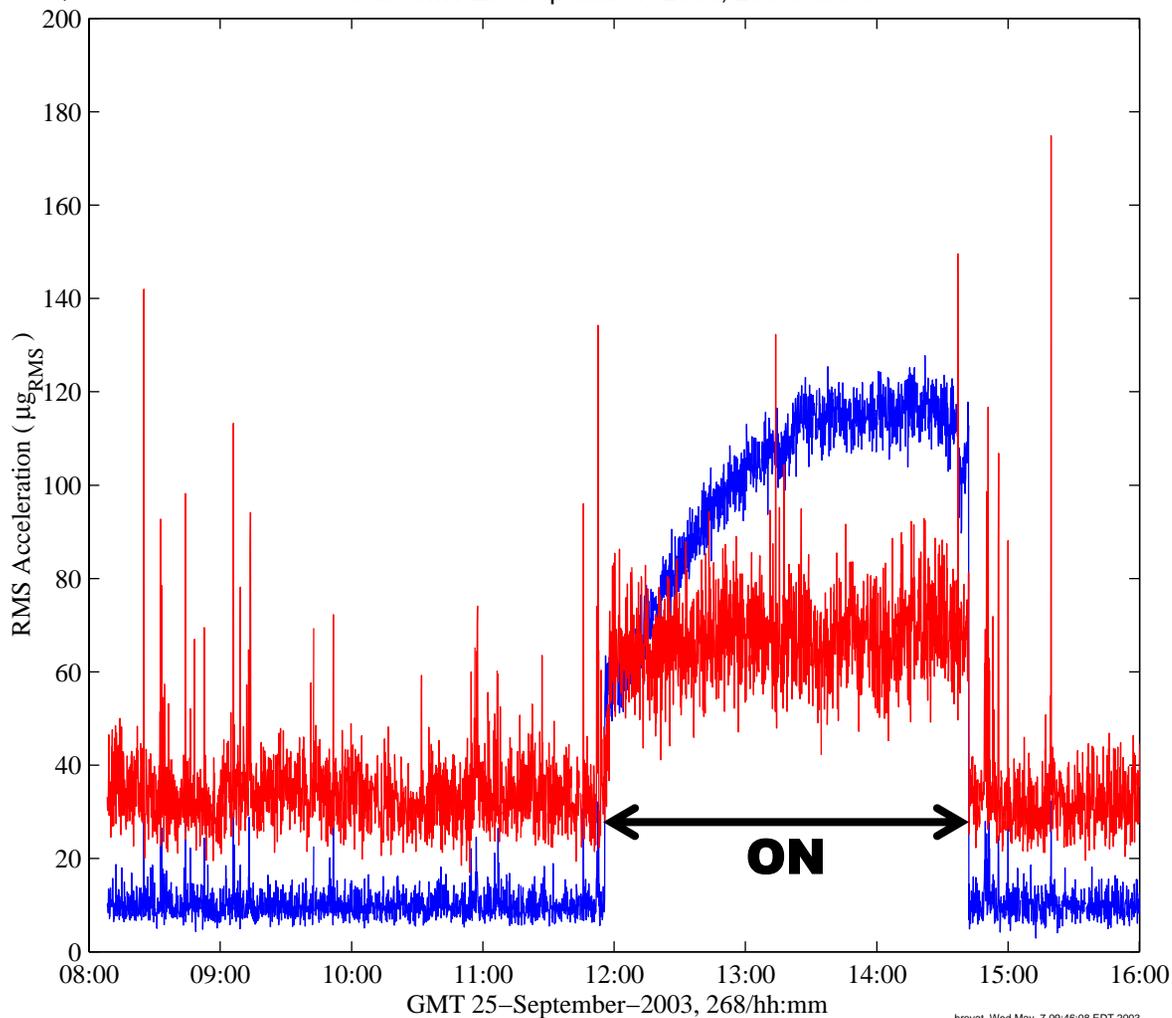

Data Description	
Sensor	121f05 250.0 sa/sec (100.0 Hz)
Location	LAB1O1, ER2, Upper Z Panel
Inc/Flight	Increment: 7, Flight: 6S
Plot Type	Interval RMS

Notes:

It's interesting to note from the interval RMS plot shown that the higher frequency (blue trace) narrowband (~89.1 Hz) disturbance gradually climbs to a steady state RMS value over the first hour or two, while the higher frequency (red trace) disturbance, more or less, steps to its steady state RMS value. Referring back to the spectrogram used to qualify the ultrasound operations, note that the lower frequency disturbance consists of twin traces at about 77.7 and 78.6 Hz. Both of these contribute to the RMS level shown in the table below, which shows a comparison of these ultrasound-related disturbances.

	RMS Acceleration (μgRMS)	
Band (Hz)	OFF	ON
77.3-78.9	32.8	66.5
88.9-89.5	9.7	107.4

For some context, the RMS level for the entire passband (up to 100 Hz) was 296.6 μgRMS for the entire day.



Microgravity Science Division



Glenn Research Center

Regime:	Vibratory
Category:	Equipment
Source:	Ultrasound Operations